


Toggle Light Switch


WARNING Never take risks with electrical safety. Always disconnect the mains power before beginning any electrical work and test that it is isolated - it is NOT enough just to turn off the light switch. Electrical products must be installed in accordance with IET regulations (BS 7671). If you are in any doubt, always consult a qualified electrician or an experienced person registered with an electrical Competent Person Scheme. Further information is available online or from your Local Authority. If the lighting circuit is not protected by a Residual Current Device (RCD) then the installation should be carried out and tested by a qualified electrician. If necessary, use a suitable stepladder, but first read the useful advice given by the Health and Safety Executive. Visit www.hse.gov.uk and search for 'using stepladders'.

Your toggle light switch

Your toggle light switch is suitable for indoor use only. Depending on the model, your switch panel will have between one and four switching channels and each can be used in either a 1-way or a 2-way circuit.

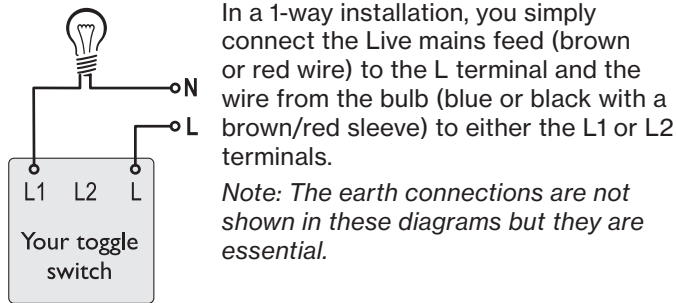


In a 2-way installation, such as a landing light that can be switched from downstairs as well as upstairs, the wiring will be achieved in either of two ways:

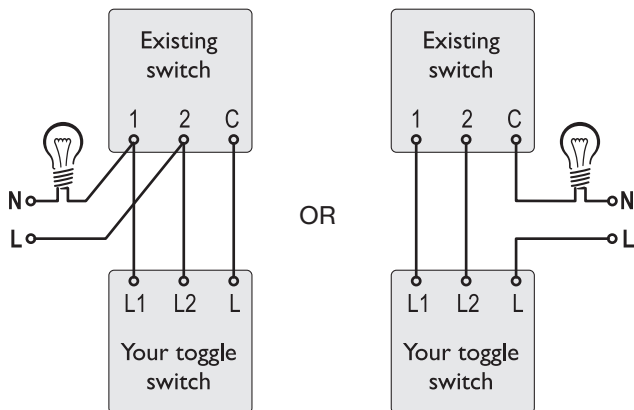

You need to connect your new switch to the circuit in exactly the same way as the one that it is replacing. This product must be installed in accordance with local building regulations.

IMPORTANT: If you are in any doubt, STOP and seek professional help. Do not proceed unless you are sure.


Remove the front cover from your switch. Insert a small flat blade screwdriver into one of the base slots and carefully prise off the front cover.

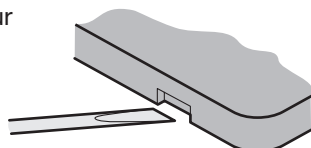

- 1 Ensure that the mains supply to the lighting circuit is isolated. Double check that all circuits are dead.
- 2 Remove the two wall screws securing the existing switch. Take a photo of the existing connections, then disconnect the wires and remove it from the installation.
- 3 Connect the wires to your switch in the same way that they were connected to the previous one. If there are two separate channels, be sure not to mix their connections.

The L connection is the common connection (most often connected to the live feed of the circuit)

L1 and L2 are the switched connections (the L terminal links either to L1 or L2 when you click the switch)

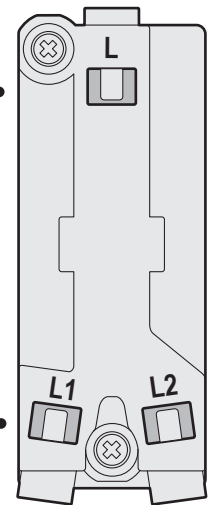

Switch rating: 250VAC, 10AX

- 4 Ensure that a valid earth connection is made to the earth terminal of your toggle switch. Ensure that the bare copper earth connections have green/yellow sleeves to isolate them from other connections. Check that screw terminals are properly tightened and that no bare wires remain unsheathed.



- 5 Secure your switch in place and test it.

